

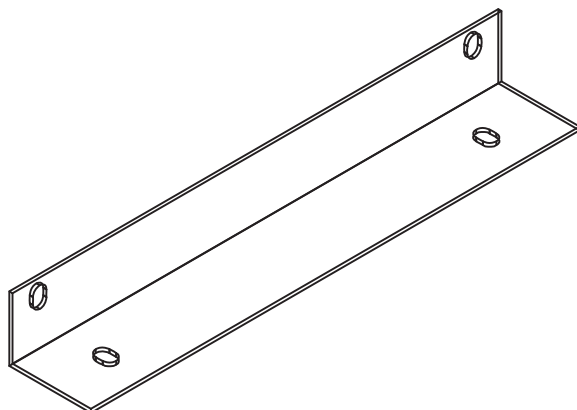
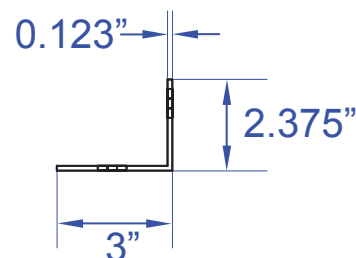


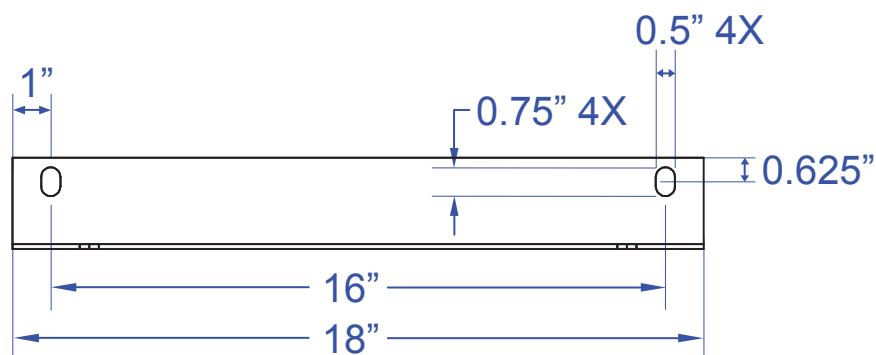

Notes:

1. Use 11Ga galvanized or 10ga CRS Painted DSPM Gray
2. Use minimum bend radius
3. Deburr all edges
4. Two required per unit
(With the exception of the Mini unit which only one is required)

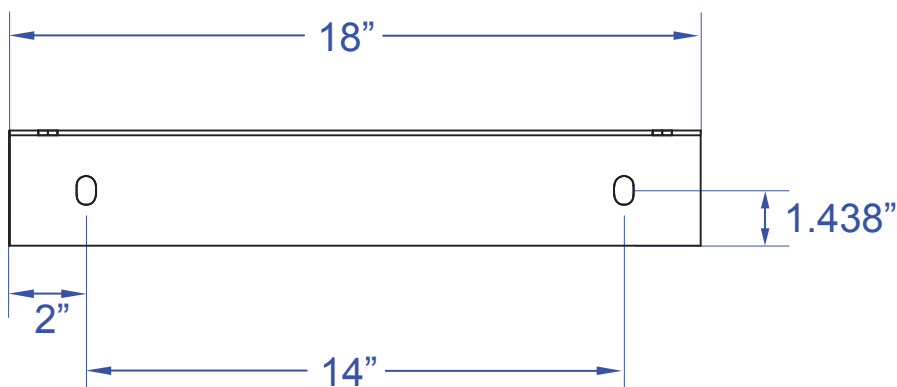

Seismic
Bracket

Drawing #
052-0028-00

Drawing by: H.A. Berger



439 S. Stoddard Avenue
San Bernardino, CA 92401
Ph: 1.877.DSPM POWER
1.877.377.6769
Fax: 909.930.3335
E-Mail: engineering@dspmanufacturing.com

Revision
Level
C

Sheet 1 of 1